


TRANSMITTAL OF SHOP DRAWING, EQUIPMENT DATA, MATERIAL, SAMPLES, OR MANUFACTURE'S CERTIFICATES OF COMPLIANCE <small>(Read instructions on reverse side prior to initiating this form)</small>	DATE 15 APR '13	TRANSMITTAL NO. 08 11 13 - 1.1 44
--	---------------------------	--

SECTION 1-REQUEST FOR APPROVAL OF THE FOLLOWING ITEMS (This section will be initiated by the contractor)

TO: C.A.B CONSTRUCTION DIV. USAEDFE UNIT # 15546 APO AP 96205-0610	FROM: KRIMA CONSTRUCTION CORP.	CONTRACT NO. W912UM-12-C-0034	CHECK ONE <input type="checkbox"/> THIS IS A NEW TRANSMITTAL <input checked="" type="checkbox"/> THIS IS A RE-SUBMITTAL OF TRANSMITTAL 08 11 13 - 1
SPECIFICATION SEC. NO. (cover only one section with each transmittal) 08 11 13	PROJECT TITLE AND LOCATION : FY11 OMAF, 11-1061, Demolish/Consolidation Communication Bldg #511/512 & MLWR11-1062, Bldg #950/954, Kunsan Air Base, Korea		CHECK ONE: THIS TRANSMITTAL IS FOR <input type="checkbox"/> FIO <input checked="" type="checkbox"/> GOV'T. APPROVAL

ITEM NO	DESCRIPTION OF ITEM SUBMITTED <small>(Type size, model number/etc.)</small>	MFG OR CONTR. CAT. CURVE DRAWING OR BROCHURE NO. <small>(See instruction no. 8)</small>	NO OF COPIES	CONTRACT REFERENCE DOCUMENT		FOR CONTRACTOR USE CODE	VARIATION <small>(See instruction No. 6)</small>	FOR CE USE CODE
				SPEC PARA NO.	DRAWING SHEET NO.			
a.	b.	c.	d.	e.	f.	g.	h.	i.
2	SECURITY INSULATED METAL DOOR W/ METAL FRAME	DATA	5	2.8	A-AE606	A		AKLS
	3HR Fire Rated, U.L. Labeled, Meet NEPA 80 Requirement, Level III, Heavy Duty							
	Impact and Thermal Resistance, Mechanically Interlocked, Hemmed Vertical Edge Seam							
	Full Flush Design, Frame #12GA, Door#12GA. Formed-Place Polyurethane Core							
	Concrete Wall Type 4- Existing Opening Anchor Per Each Jamb, 2each at head							
	Hot- Dipped Galvanized Steel, Conforming to KS D 3506,							
	Frame Size : 45 mm Face & 146mm Depth w/ 15mm Backbend							
	R.Opening Size : 1727mmW X 2184mmH							
	Door Size : 1627mmW X 2134mmH X 45mm THK							
	MFR : Sammhoon Co., Ltd.							
	POU : Bldg. 511&512 Door No. D26							

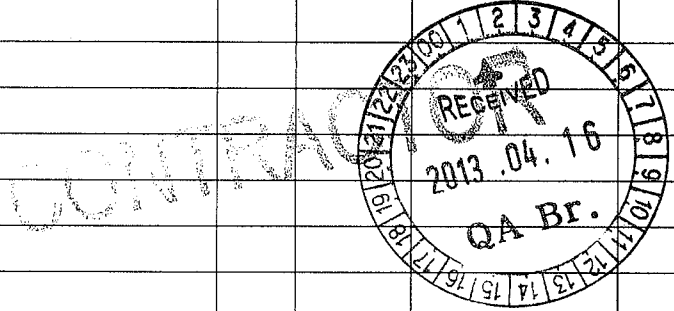

I certify that the above submitted items have been reviewed in detail and are correct and in strict conformance with the contract drawings and specifications except as other wise stated

KIM SUNG HYUN
KIM SUNG HYUN / CQC

NAME AND SIGNATURE OF CONTRACTOR

SECTION II-APPROVAL ACTION

ENCLOSURES RETURNED(List by Item No.)	NAME, TITLE AND SIGNATURE OF APPROVING AUTHORITY 	DATE 5/10/13
---------------------------------------	--	------------------------

HARDWARE SCHEDULE

BLDG #511/512

KEY NO.	DR. TYPE or Q'TY	HARDWARE, HANDING AND LOCATION, ETC.	
		HEADING 12 (D26)	
F		SECURITY INSULATED DOOR / FRAME EXTRA HEAVY DUTY DOOR (3-HR FIRE RATING) 1627W x 2134H x 44.5 THK (DOOR DIMENSION)	
		D26 : CORRIDOR (104) TO CUSTOMER SERVICE LOBBY (125)	RHRA-1 LHR-1
		(HW-12)	
6 EA		HINGES, A5112, 114 x 114	PBB #BB51 / 114 x 114 / NRP 630
1 EA		LOCKSET, 1000-1, F07 (LEVER HANDLE TYPE)	TOWNSTEEL #MSE-R-07 / SENTINEL / IC 630
2 EA		CLOSER, C02011	KING #K900-BC 689
2 EA		DOOR STOPS, L02161	LOCAL #LOCAL / L02161 626
2 EA		KICK PLATE, J102, SST	LOCAL #LOCAL / J102 630
1 EA		THRESHOLD, J32100	LOCAL #LOCAL / J32100 ALUM
1 EA		ELEC HINGE	PBB #BB51EL2W 630
1 EA		ELEC STRIKE	HES #4500 630
1 EA		CONTROL PANEL	CONTINENTAL #S100 / A21
1 EA		PUSH BUTTON PANEL	CONTINENTAL #A15 / A6